

25X1X

There are available in the GIA Library the following sketches of the Subotica electric power network:

- a. Main plan of the Subotica electric plant.
- b. Subotica power line layout.
- c. Subotica power line tabular presentation of power transmission.
- d. Plan of available power for 1950.
- e. Project for revision of the Subotica electric power network.

Decument No	07
No Change In Class.  Declassified Class. Changed To: TS	
Auth.: HR 70-2 Date:O(O8/78	By: <u>029</u>

## CONFIDENTIAL

	one of the second secon	1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1	TION	The state of the s	
STATE		<b>ม</b> แอลอ		DISTALBUTION	İ
ARMY	AIR	FBI			٦

PRINCIPIELNA ŠIMA ELEKTRANE SUBOTICE

CONFIDENTIAL POTROGNJA DPŽ. ŽELEZNICA GORNJI GRAD SENTA - ČOKA DONJI GRAD PRETVARAC SOPSTVENA CENTRUM FERU M PALIC 35 V 231 V. 108 V.

PRILOG 1. affachment 1

450 V

CONFIDENTIAL

Approved For Release 1999/09/09-CIA-RDP82-00457R007400070009-8


CONFIDENTIAL

Approved For Release 1999/09/09: CIA-RDP82-00457R0074

U.S. OFFICIALS ONLY

25X1A

(Power) LINE LINIJA DONJI GRAD SUBOTICA

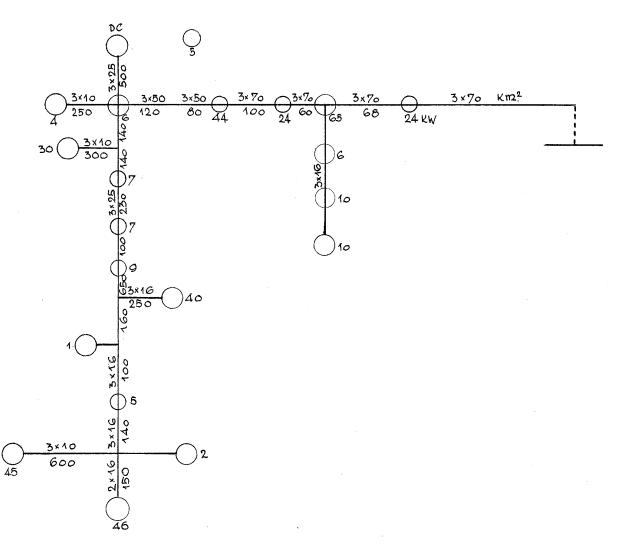


PRILOG 2 attachement 2

CONFIDENTIAL

THERET CONTROL



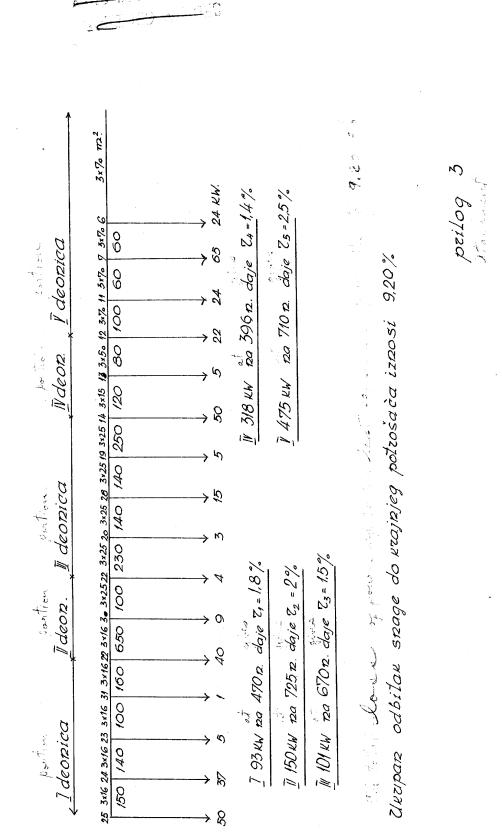

TDENTIAL


CONFIDENTIAL

Approved For Release 1999/09/09 : CIA-RDP82-00457R00740007

25X1A

Plan of available Power for 1950

PLAN RASPOLOŽIVI SNAGI ZA 1950

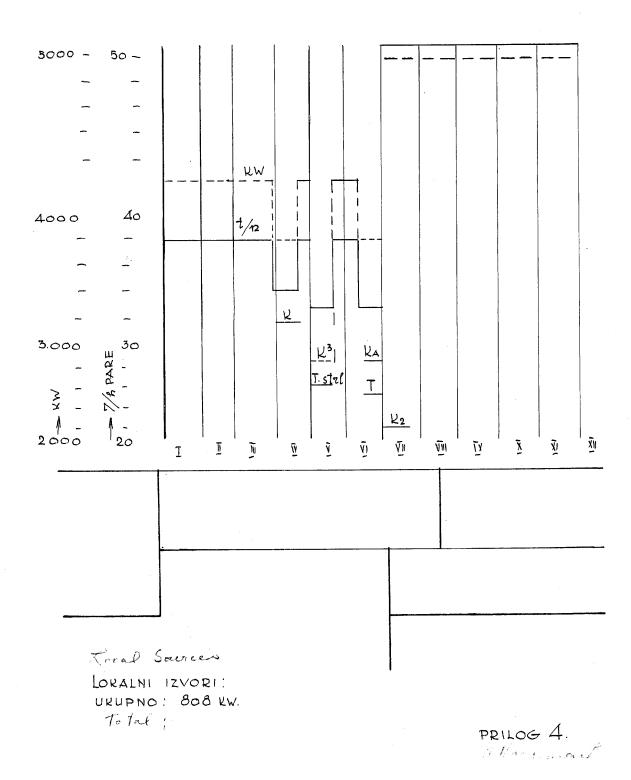

CONFIDENTIAL

Approved For Release 1999/09/09; CIA-RDP82-00457R007400070009-8

DRŽ. ŽELEZN. GORNSI GRAD CENTRUM VETSERUM 33000V 400 K.V.A. 3 30/6 (10/3) N FERUM SENTA 30/6 (10/3) ? 10 (6,6) N ZORKA PALIÉ PRSTV. PRSTV. I VATSERUM 30/6 (10/3) 10 (6,6 KW)

From the stricted the time lange

50-1-6

skica 5

CONFIDENTIAL